OnSpeX™
Consumer Product Evaluation

"GET GREEN SYSTEM" COMPARISON

Prepared for:
Mr. George Prior
Green Energy Technologies, Inc.
2320 Bristol Circle
Unit #1
Oakville, ON L6H-5S3
Phone: 905-829-1114
Fax: 905-829-1141

Technical Report Number
30017717

Test Protocol
Green Energy Get Green Comparison

February 10, 2011

Prepared by:

Nancy A. Wilson

Nancy Wilson, Certified Gas Engineer
Technical Team Lead - Gas Products

Approved by:

Mark A. Knaus

Mark Knaus, Technical Manager- Cleveland

OnSpeX™
Consumer Product Evaluation

Program Description

Comparison of natural gas powered low intensity infrared tube heater with and without "Get Green System" using test methods derived from ANSI Z83.20 - 2008 Gas Fired Low Intensity Infrared Heaters.

Executive Summary

An Ener-Radient EXRL-100S (serial #106186) natural gas powered infrared radiant tube heater head was mounted to a Roberts Gordon 30 foot hot rolled steel heat exchanger kit; this assembly was then subjected to tests detailed in this report. The determination from the findings is that the use of the Get Green® device does not negatively affect the performance or safety aspects of the heater.

The conditions observed during testing are contained in this report.

Components

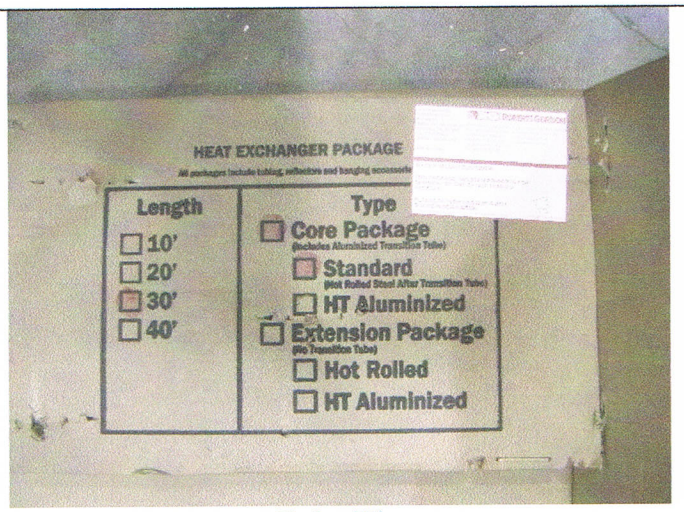

Tube Kit

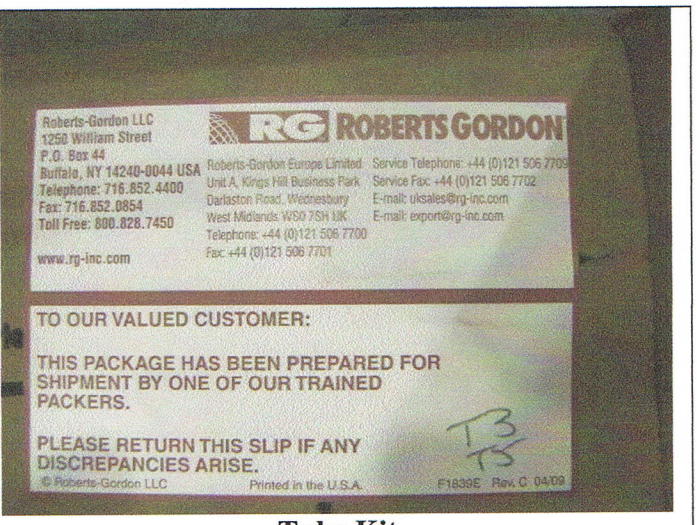

Tube Kit

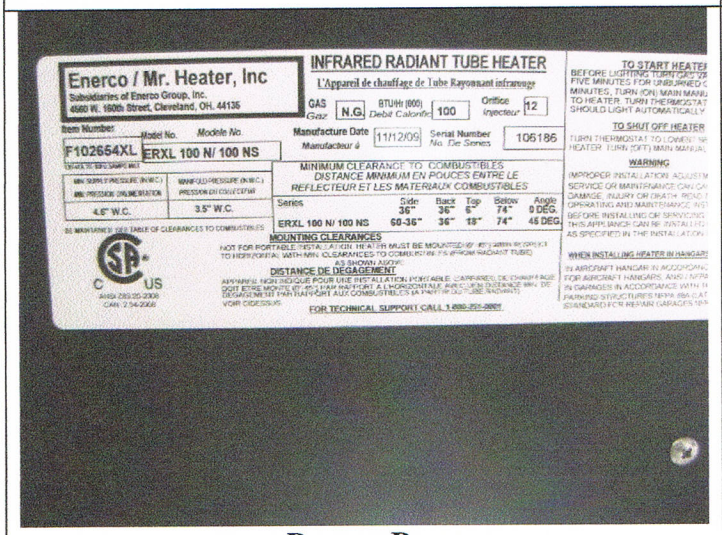

Burner Box

Get Green Device, installed